


Technical Construction File

TCF No.: ZDE-22001007-2 / 07.October.2022

Certificat Holder	Zhejiang Dabo Electric Co., Ltd
Address	No. 79, Longhui Road, Houxi Village, Beibaixiang Town, Leqing City, Wenzhou City, Zhejiang Province
Manufacturer	Zhejiang Dabo Electric Co., Ltd
Address	No. 79, Longhui Road, Houxi Village, Beibaixiang Town, Leqing City, Wenzhou City, Zhejiang Province
Equipment Name	Moulded Case Circuit-breaker
Equipment All Model	SEE NEXT PAGE
Major Model	YTTM1- 125/2300, YTTM1-250/PV2, YTTM1-250/ 1300Z, YTTM1-250/3300, YTTM1-250/ 4300, NBL7-63, DZ47Z-63, NBT2- 125DC、 YTM1-400/4300Z、 YTM1-125/4300Z
According To	Electromagnetic Compatibility Directive (2014/30/EU)
Reviewed By	<i>Liqian wang</i>
Prepared By	Zhejiang Dabo Electric Co., Ltd
Controlled by	Beijing United-Standard, Product, Testing & Technical Service Co.,Ltd No.2109,Building 401 WangJing Yuan,Chaoyang District,Beijing City,China 

Equipment All Model:

**YTTM1- 125/2300, YTTM1-250/PV2, YTTM1-250/ 1300Z, YTTM1-250/3300, YTTM1-250/
4300, NBL7-63, DZ47Z-63, NBT2- 125DC、 YTM1-400/4300Z、 YTM1-125/4300Z**

Catalog Of The TCF

Part I:Description Of The Product-----	3~4
Part II:EMC Measurement & Test Report-----	5~28
Part III:Declaration of Conformity-----	29

Part I: Description Of The Product

Equipment Name: Moulded Case Circuit-breaker

Equipment Major Model: YTTM1- 125/2300, YTTM1-250/PV2, YTTM1-250/ 1300Z, YTTM1-250/3300, YTTM1-250/ 4300, NBL7-63, DZ47Z-63, NBT2- 125DC、 YTM1-400/4300Z、 YTM1-125/4300Z

1.1 EUT Photographs



Part II:EMC Measurement & Test Report

EMC MEASUREMENT AND TEST REPORT

Test Report No.: ZDE-22001007-2 / T

Certificat Holder	Zhejiang Dabo Electric Co., Ltd
Address	No. 79, Longhui Road, Houxi Village, Beibaixiang Town, Leqing City, Wenzhou City, Zhejiang Province
Manufacturer	Zhejiang Dabo Electric Co., Ltd
Address	No. 79, Longhui Road, Houxi Village, Beibaixiang Town, Leqing City, Wenzhou City, Zhejiang Province
Equipment Name	Moulded Case Circuit-breaker
Major Model	YTTM1- 125/2300, YTTM1-250/PV2, YTTM1-250/ 1300Z, YTTM1-250/3300, YTTM1-250/ 4300, NBL7-63, DZ47Z-63, NBT2- 125DC、YTM1-400/4300Z、YTM1-125/4300Z
According To	Electromagnetic Compatibility Directive (2014/30/EU)
Test Standards	EN IEC 61000-3-2:2019+A1:2021 EN 61000-3-3:2013+A2:2021
Test Engineer	<i>HABIM NI</i>
Verify Engineer	<i>MMXU</i>
Test Date	07.October.2022
Issuance Date	07.October.2022

Test item	
Description:	Moulded Case Circuit-breaker
Model and/or type reference:	YTTM1- 125/2300, YTTM1-250/PV2, YTTM1-250/ 1300Z,YTTM1-250/3300, YTTM1-250/ 4300, NBL7-63, DZ47Z-63,NBT2- 125DC、YTM1-400/4300Z、 YTM1-125/4300Z
Manufacturer :	Zhejiang Dabo Electric Co., Ltd

Emission Tests (EN IEC 61000-3-2:2019+A1:2021, EN 61000-3-3:2013+A2:2021)			
Test Standard	Test Items	Measured	Result
EN IEC 61000-3-2:2019+A1:2021, Class A	Harmonic Currents	Compliant	Pass
EN 61000-3-3:2013+A2:2021	Voltage Fluctuations and Flickers	Compliant	Pass
N/A means Not Applicable.			

Immunity Tests (EN 60974-10:2014)				
Test Standard	Description of Test	Pass Criterion	Result	
IEC 61000-4-2:2008	Electrostatic Discharge Contact discharge: ± 4 kV, Air discharge: ± 8 kV	B	Pass	
IEC 61000-4-3:2010	Radio Frequency Electromagnetic Field 3 V/m, 1 kHz, AM, 80%, 80 MHz-1000 MHz	A	Pass	
IEC 61000-4-4:2012	Fast Transients ± 0.5 kV, ± 1 kV, 5/50 Tr/Th ns, 5kHz	B	Pass	
IEC 61000-4-5:2014	Surges Line to line: ± 1 kV (peak)	B	Pass	
IEC 61000-4-6:2013	Radio-frequency continuous conducted 3 V (unmodulated, r.m.s), 0,15 MHz-80 MHz 80% AM (1kHz)	A	Pass	
IEC 61000-4-11:2004	Voltage Dips	>95% residual voltage, 0.5 period	B	Pass
		30% residual voltage, 25 periods	C	Pass
IEC 61000-4-11:2004	Voltage Interruptions	>95% residual voltage, 250 periods	C	Pass

Performance Criteria Description

Performance Criteria	
Performance criterion A	During and after the test the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed below a minimum performance level specified by the manufacturer when the EUT is used as intended. The performance level may be replaced by a permissible loss of performance. If the minimum performance level or the permissible performance loss is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and by what the user may reasonably expect from the EUT if used as intended.
Performance criterion B	After the test, the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed, after the application of the phenomena below a performance level specified by the manufacturer, when the EUT is used as intended. The performance level may be replaced by a permissible loss of performance. During the test, degradation of performance is allowed. However, no change of operating state or stored data is allowed to persist after the test. If the minimum performance level (or the permissible performance loss) is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and by what the user may reasonably expect from the EUT if used as intended.
Performance criterion C	During and after testing, a temporary loss of function is allowed, provided the function is selfrecoverable, or can be restored by the operation of the controls or cycling of the power to the EUT by the user in accordance with the manufacturer's instructions.

TABLE OF CONTENTS

1 General Description

1.1 Information-----	10
1.2 Test Equipment List-----	10-11
1.3 Description of Test Facility-----	12

2 Emission Tests

2.1 Conducted Emission-----	13-15
2.2 Radiated Emission-----	16-18
2.3 Harmonic Current Emission-----	19-20
2.4 Voltage Fluctuations and Flickers-----	21

3 Immunity Tests

3.1 Electrostatic Discharges-----	22
3.2 Radio Frequency Electromagnetic Field-----	23
3.3 Fast Transients-----	24
3.4 Surges-----	25
3.5 Injected Currents-----	26
3.6 Voltage Dips & Interruptions-----	27

4 Product Labeling

4.1 CE Mark Label Specification-----	28
4.2 Proposed Label Location on EUT-----	28

1. General Description

1.1 Information

1.1.1 Description of Equipment under Test (EUT)

Description	Moulded Case Circuit-breaker
Model and/or type reference	YTTM1- 125/2300, YTTM1-250/PV2, YTTM1-250/1300Z, YTTM1-250/3300, YTTM1-250/ 4300, NBL7-63, DZ47Z-63, NBT2- 125DC、YTM1-400/4300Z、YTM1-125/4300Z

1.1.2 Test Mode

The equipment was tested under normal operating according to the manufacturer's instruction

1.1.3 Accessories used during testing

AC/DC power transformer used. (I/P: 230Va.c./50Hz, O/P: 24Va.c.)

1.2 Test Equipment List

Test Item	Disturbance Voltage				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
EMI Test Receiver	R&S	EPSI	101611	2016-01-10	1 year
L.I.S.N.	Schwarz beck	NSLK8126	8126-224	2016-01-10	1 year
Pulse Limiter	R&S	ESH3-Z2	100911	2016-01-10	1 year
Current Probe	FCC	F-33-4	091684	2016-01-10	1 year

Test Item	Radiated Electromagnetic Disturbance				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
Spectrum Analyzer	R&S	FSP	836079/035	2016-01-10	1 year
EMI Test Receiver	R&S	ESVB	825471/005	2016-01-10	1 year
Pre-amplifier	Agilent	8447F	3113A06717	2016-01-10	1 year
Pre-amplifier	Compliance Direction	PAP-0118	24002	2016-01-10	1 year
Trilog Broadband Antenna	SCHWARZBECK	VULB9163	9163-333	2016-01-10	1 year
Horn Antenna	ETS	3117	00086197	2016-01-10	1 year

Test Item	Harmonic Currents & Flickers				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
Digital Power Analyzer	California Instrument	CTS	72831	2016-01-10	1 year
Power Source	California Instrument	5001IX-CTS-400	60077	2016-01-10	1 year

Test Item	ESD				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
ESD Generator	TESQ AG	NSG 437	161	2016-01-10	1 year

Test Item	Radio Frequency Electromagnetic Field				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
Signal Generator	R&S	SMT03	100059	2016-01-10	1 year
Voltage Probe	R&S	URV5-Z2	100013	2016-01-10	1 year
Power Amplifier	AR	150W1000	300999	2016-01-10	1 year
Power Amplifier	AR	25S1G4AM1	305993	2016-01-10	1 year
Trilog Antenna	SCHWARZBECK	VULB9163	9163-333	2016-01-10	1 year
Anechoic chamber	Albatross Projects	MCDC	---	2016-01-10	1 year

Test Item	Fast Transients				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
Transient 2000	EMC PARTNER	TRA2000	863	2016-01-10	1 year
Coupling Clamp	EMC PARTNER	CN-EFT1000	513	2016-01-10	1 year

Test Item	Surges				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
Transient 2000	EMC PARTNER	TRA2000	863	2016-01-10	1 year

Test Item	Injected Currents				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
CS Immunity Tester	EMTEST	CWS500	0900-03	2016-01-10	1 year
Attenuator	EMTEST	MA-500	1009	2016-01-10	1 year
CDN	Luthi	L-801M2/M3	2665	2016-01-10	1 year

Test Item	Voltage Dips & Short Interruptions				
Instrument	Manufacturer	Model No.	Serial No.	Calibration Date	Calibration Interval
Transient 2000	EMC PARTNER	TRA2000	863	2016-01-10	1 year

1.3 Description of Test Facility

All measurement facilities used to collect the measurement data are located at Beijing TIRT Technology Co., Ltd.

2. Emission Tests


2.1 Conducted Emission

Result: Pass

Test standard : EN 55022:2010/AC:2011

Frequency range : 0.15-30MHz

Test Setup

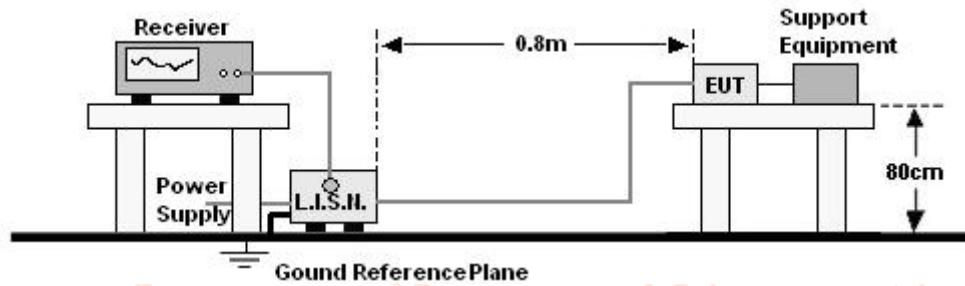

Input Voltage : 230Va.c./50Hz (Output: 4Vd.c.)

Operation Mode : Running

Earthing : Not pplied

Temperature : 26°C

Humidity : 60%

Test Limit


Frequency MHz	Class B Limits (dB μ V/m)	
	Quasi-peak Level	Average Level
0.15 to 0.50	66-56*	56-46*
0.50 to 5.00	56	46
0.50 to 30.00	60	50

Notes: 1. *Decreasing linearly with logarithm of frequency.


2. The lower limit shall apply at the transition frequencies.

Table: Test Data refer to next pages.

Test Specification: Line

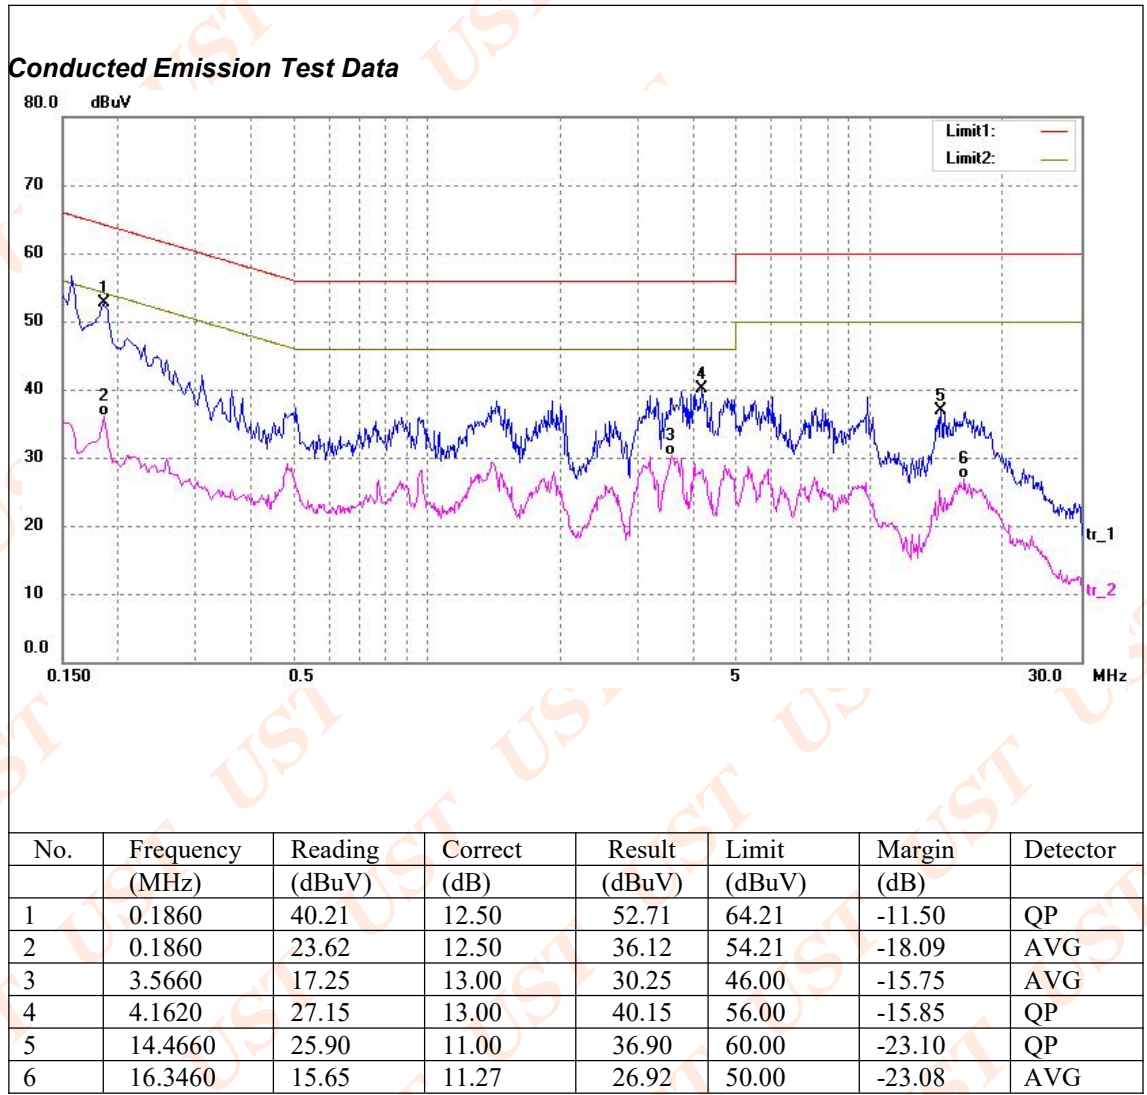

Test Specification: Neutral

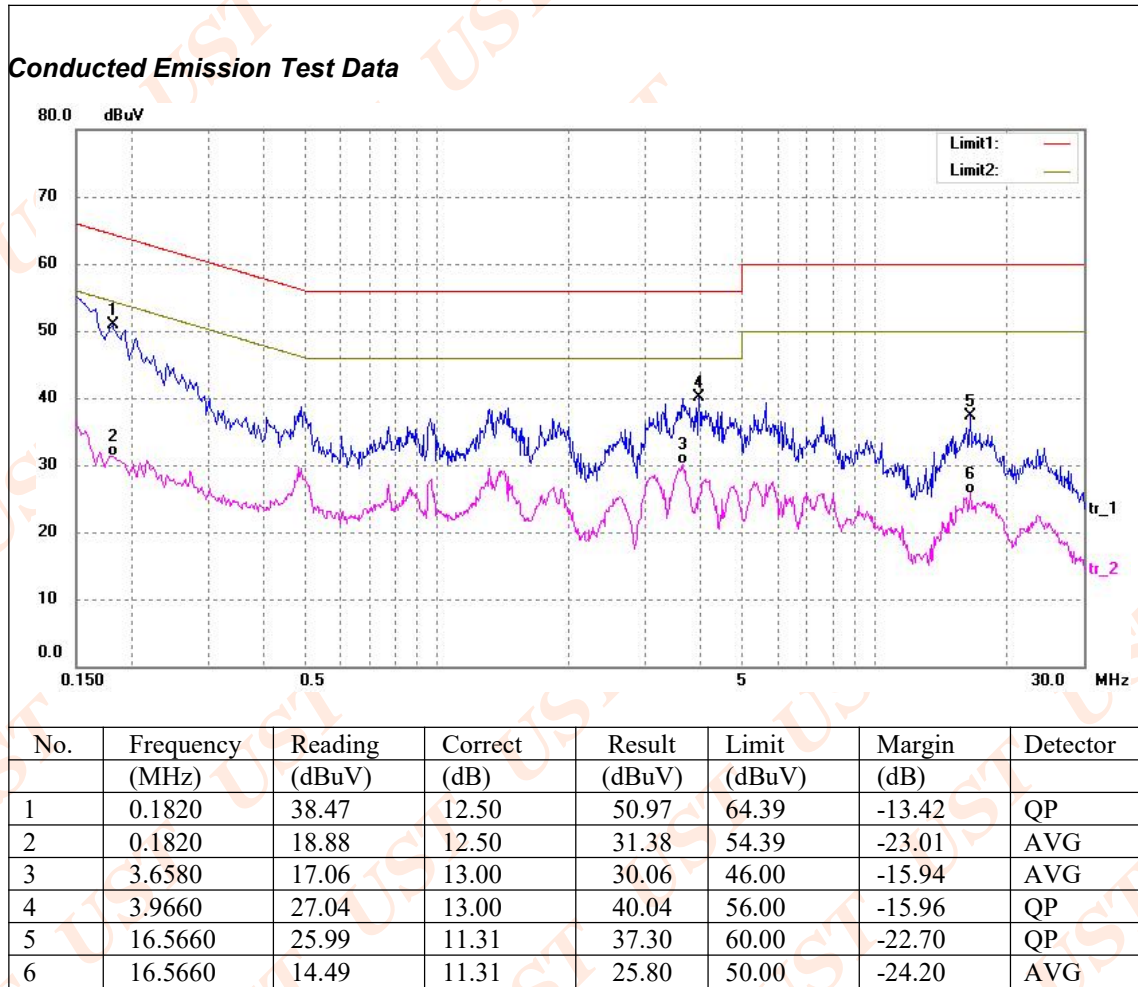


2.2 Radiated Emission

Result: Pass

Test standard : EN 55022:2010/AC:2011

Frequency range : 30-1000MHz

Test Setup

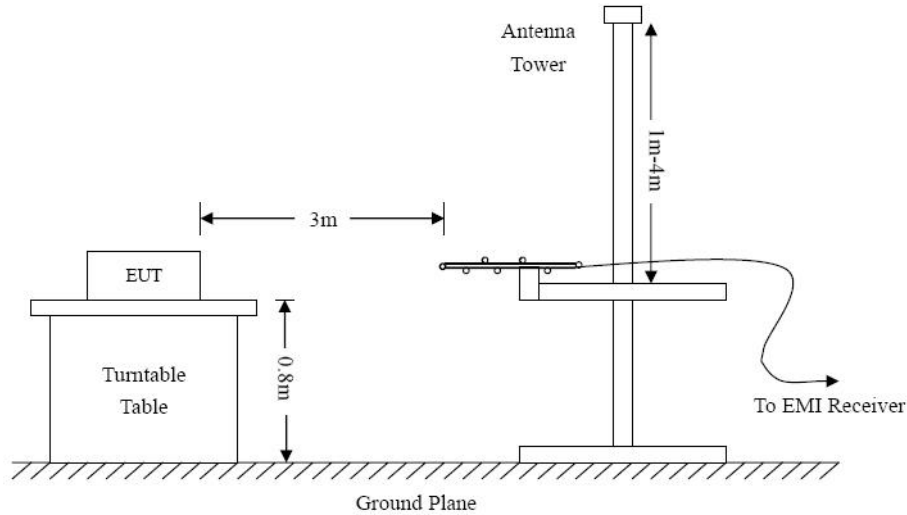

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied

Temperature : 24°C

Humidity : 60%


Test Limit

Frequency (MHz)	Distance (Meters) (In SAC*)	Limits (dB μ V/m)
30 - 230	3	40
230 - 1000	3	47


*SAC=Semi-Anechoic Chamber

Table: Test Data refer to next pages.

Test Specification: Horizontal

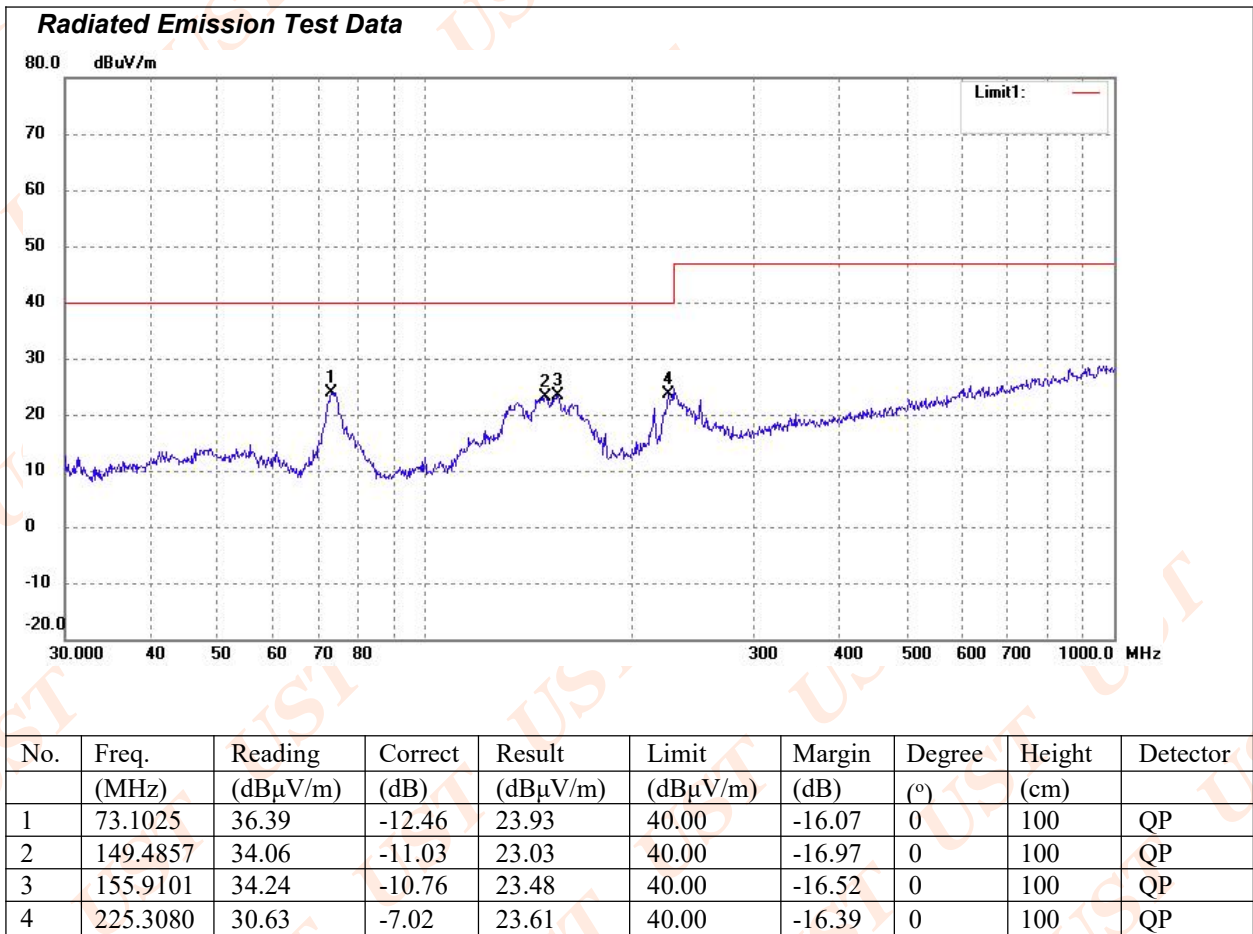

Test Specification: Vertical

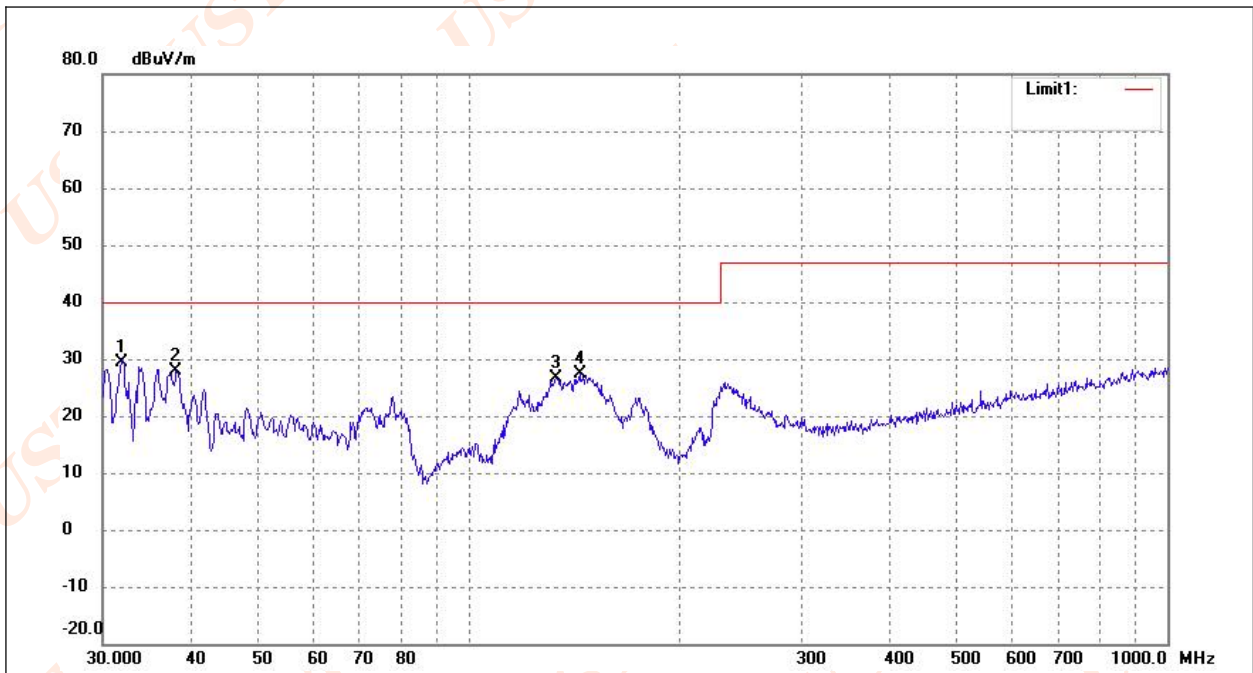


No.	Freq. (MHz)	Reading (dB μ V/m)	Correct (dB)	Result (dB μ V/m)	Limit (dB μ V/m)	Margin (dB)	Degree ($^{\circ}$)	Height (cm)	Detector
1	31.9546	40.53	-11.03	29.50	40.00	-10.50	0	100	QP
2	38.2120	38.01	-10.11	27.90	40.00	-12.10	0	100	QP
3	133.6188	37.43	-10.79	26.64	40.00	-13.36	0	100	QP
4	144.3348	38.31	-10.95	27.36	40.00	-12.64	0	100	QP

2.3 Harmonic Current Emission

Result: n.a.

Test standard : EN IEC 61000-3-2:2019+A1:2021 Measured harmonics : 2-40
Class : A

Test Setup

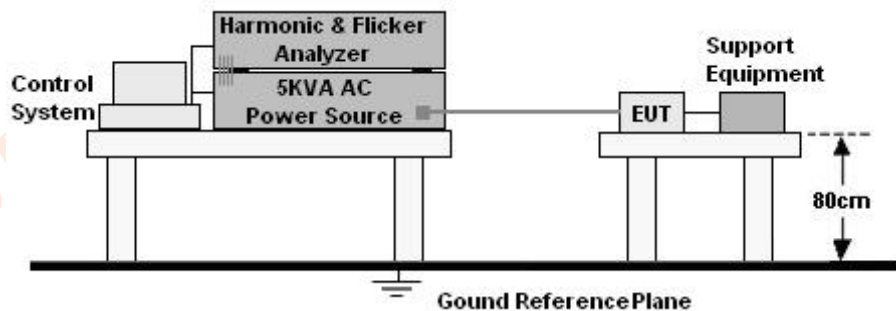

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)
Operation Mode : Running
Earthing : Not Applied
Temperature : 25°C
Humidity : 60%

Table: Test Data refer to next pages.


2.4 Voltage Fluctuations and Flickers

Result: Pass

Test Standard : EN 61000-3-3:2013+A2:2021

Limits: EN 61000-3-3:2013+A2:2021 clause 5

Test Setup

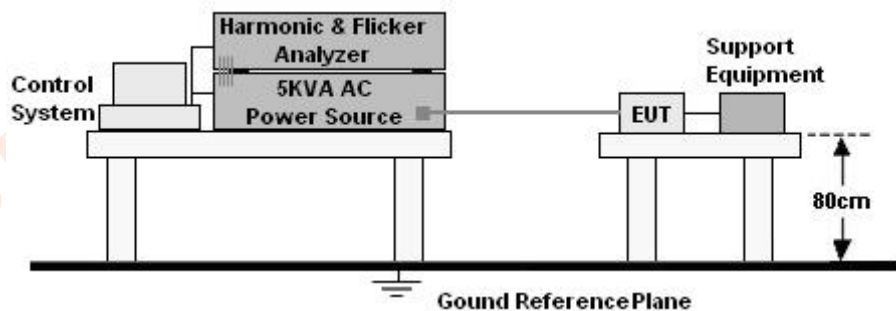

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied

Temperature : 25°C

Humidity : 60%

Table: Test Data

Test Items	Measured values	Limits	Results
Pst	0.061	1.00	PASS
Plt	0.036	0.65	PASS
dc[%]	0.028	3.30	PASS
dmax[%]	0.135	4.00	PASS
dt[s]	0.000	0.50	PASS

3 Immunity Tests

3.1 Electrostatic Discharges

Result: Pass

Test standard : IEC 61000-4-2:2008, EN 55024:2010

Charge voltage : $\pm 2.0\text{kV}$, $\pm 4.0\text{kV}$ (contact discharge); $\pm 2.0\text{kV}$, $\pm 4.0\text{kV}$, $\pm 6.0\text{kV}$, $\pm 8.0\text{kV}$ (air discharge)


Number of discharge : ≥ 10

Polarity : Positive /

Negative Performance

criterion: B

Test Setup

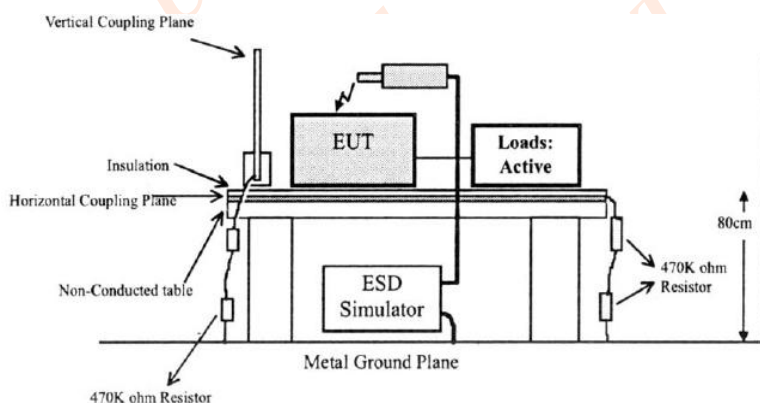

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied Temperature : 25°C

Humidity : 60%

Table: Electrostatic Discharge, both Polarities

Discharge points	Type of discharge	Criterion	Result	Remarks
All exposed non-metallic enclosure/part	Air	B	Pass	During the test, degradation of performance is allowed. After the test, the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss of function.
All exposed metallic enclosure/part	Contact	B	Pass	
HCP	Indirect Contact	B	Pass	
HCP	Indirect Contact	B	Pass	

3.2 Radio Frequency Electromagnetic Field

Result: Pass

Test standard : IEC 61000-4-3:2010, EN 55024:2010

Criterion : A


Test level : 3V/m (unmodulated, rms.)

Frequency range : 80-1000MHz

Modulation : 1kHz sine-wave, 80% AM

Sweep step : 1%

Test Setup

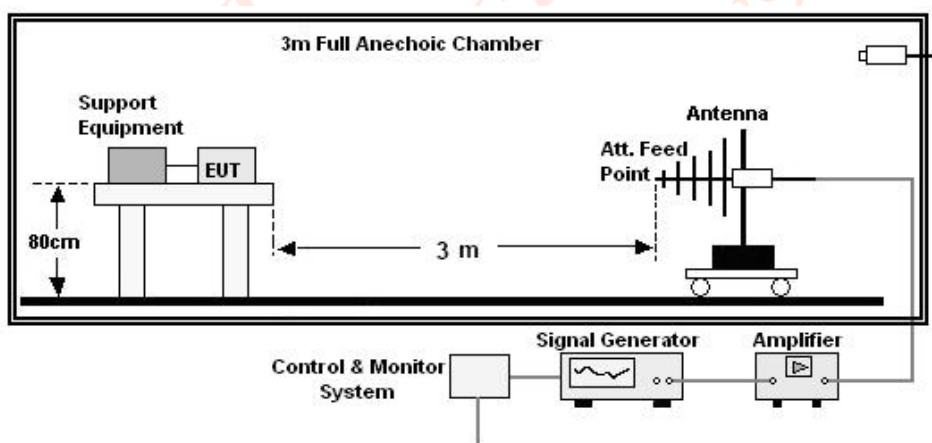

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied

Temperature : 26°C

Humidity : 60%

Table: Radio Frequency Electromagnetic Field

Coupling port	Coupling method	Strength	Criterion	Result	Remarks
Horizontal Vertical	Left, Right Front, Rear	3V/m (r.m.s)	A	Pass	During and after the test the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss.

3.3 Fast Transients


Result: Pass

Test standard : IEC 61000-4-4:2012, EN 55024:2010

Criterion : B

Test level : 0.5 kV(peak), 1 kV(peak), 5/50 Tr/Th ns, 5kHz repetition frequency

Test Setup

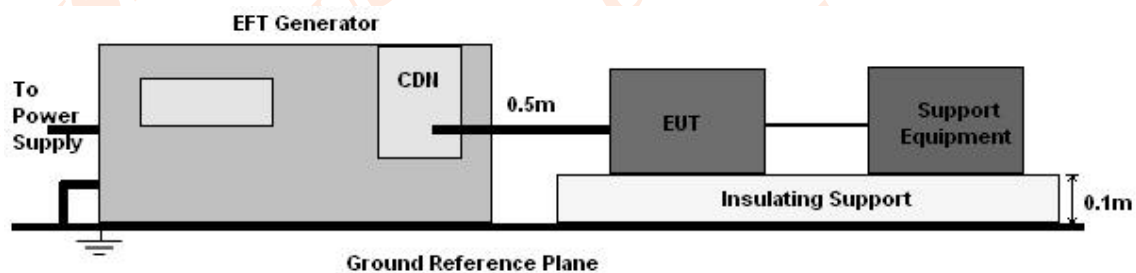

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied

Temperature : 25°C

Humidity : 60%

Table: Fast Transients

Coupling port	Test Level	Criterion	Result	Remarks
AC mains power port	1 kV(peak)	B	Pass	During the test, degradation of performance is allowed. After the test, the EUT shall continue to operate as
Signal port	0.5 kV(peak)	B	Pass	intended without operator intervention. No degradation of performance or loss of function.

3.4 Surges

Result: Pass

Test standard : IEC 61000-4-5:2014, EN 55024:2010

Pulsform : 1.2/50 μ s

Test voltage : ± 1 kV line to line

Coupling : Coupling Network for AC Mains


Coupling phase : 0, $\pi/2$, π , $3\pi/2$

Number of surges : 5 (for each combination of parameters)

Repetition rate : max. 1/min

Performance Criterion : B

Test Setup

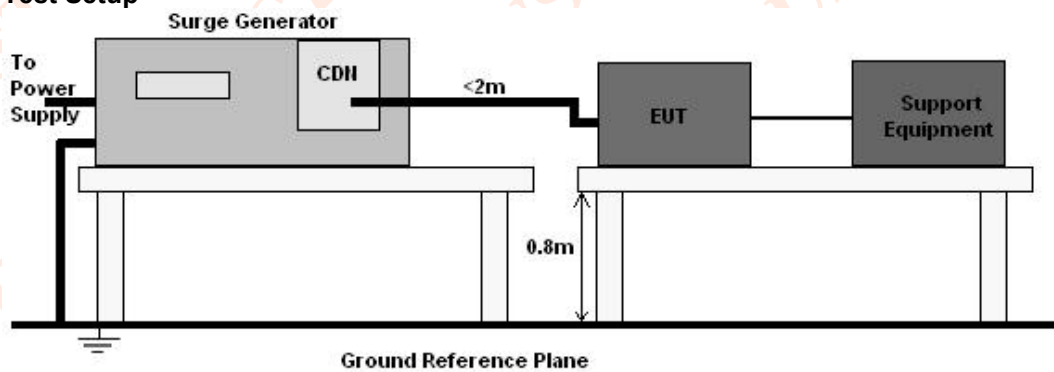

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied

Temperature : 26°C

Humidity : 60%

Table: Surges

Test port	Test voltage	Criterion	Result	Remarks
AC mains power port	± 1 kV	B	Pass	During the test, degradation of performance is allowed. After the test, the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss of function.

3.5 Radio-frequency continuous conducted

Result: Pass

Test standard: IEC 61000-4-5:2014, EN 55024:2010

Performance Criterion : A

Test level : 3 V r.m.s


Source Standard : 150Ω

Frequency range : 150kHz-80MHz

Modulation : 1kHz sine-wave, 80% AM

Sweep step : 1%

Test Setup

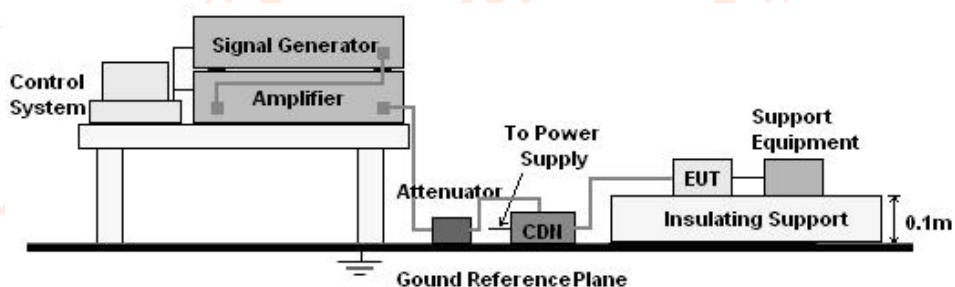

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied

Temperature : 26°C

Humidity : 60%

Table: Radio-frequency continuous conducted

Test port	Test level	Criterion	Result	Remarks
AC mains power port	3 V r.m.s	A	Pass	During and after the test the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss.
Signal port	3 V r.m.s	A	Pass	

3.6 Voltage Dips & Interruptions

Result: Pass


Test standard: IEC 61000-4-11:2004, EN 55024:2010

Voltage Dips: >95% residual voltage, 0.5 period, Performance Criteria: B

30% residual voltage, 25 periods, Performance Criteria: C

Voltage Interruption: >95% residual voltage, 250 periods, Performance Criteria: C

Test Setup

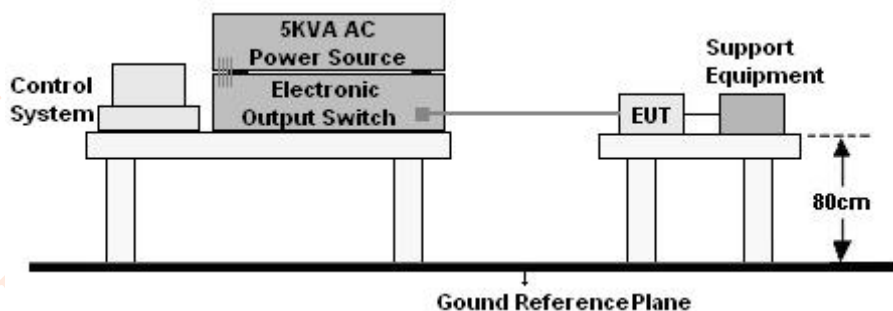

Input Voltage : 230Va.c./50Hz (Output: 24Vd.c.)

Operation Mode : Running

Earthing : Not Applied

Temperature : 26°C

Humidity : 60%

Table: Voltage Dips

Test port	Test level	Criterion	Result	Remarks
AC mains power port	>95% residual voltage, 0.5 period	B	Pass	During the test, degradation of performance is allowed. After the test, the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss of function.
	30% residual voltage, 25 periods	C	Pass	During and after testing, a temporary loss of function is allowed, provided the function is selfrecoverable.


Table: Voltage Interruptions

Test port	Test level	Criterion	Result	Remarks
AC mains power port	>95% residual voltage, 250 periods	C	Pass	During and after testing, a temporary loss of function is allowed, provided the function is selfrecoverable.

4 PRODUCT LABELING

4.1 CE Mark Label Specification

Text is Black or white in color and is left justified. Labels are printed in indelible ink on permanent adhesive backing and shall be affixed at a conspicuous location on the EUT or silk-screened onto the EUT

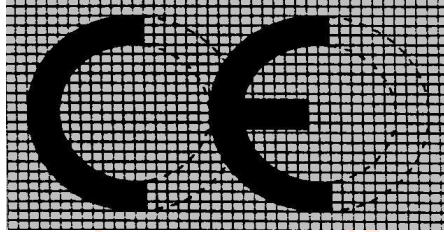

4.2 Proposed Label Location on EUT

----- End of this report -----

EC DECLARATION OF CONFORMITY

COUNCIL DIRECTIVE 2014/30/EU ON Electromagnetic Compatibility Directive WE,

Zhejiang Dabo Electric Co., Ltd
No. 79, Longhui Road, Houxi Village, Beibaixiang Town, Leqing City,
Wenzhou City, Zhejiang Province

THE PRODUCT DESCRIBED IS IN CONFORMITY WITH THE DIRECTIVE

2014/30/EU

PRODUCT TYPE: Moulded Case Circuit-breaker

PRODUCT MODEL: YTTM1- 125/2300, YTTM1-250/PV2, YTTM1-250/1300Z, YTTM1-250/3300, YTTM1-250/ 4300, NBL7-63, DZ47Z-63, NBT2-125DC、 YTM1-400/4300Z、 YTM1-125/4300Z

THE PRODUCT HAS BEEN ASSESSED BY THE APPLICATION OF THE FOLLOWING STANDARDS:

EN IEC 61000-3-2:2019+A1:2021

EN 61000-3-3:2013+A2:2021

ISSUE PLACE AND DATE

COMPANY STAMP AND SIGNATURE
OF AUTHORIZED PERSONNEL